


NOTE: CONNECT WIRING BEFORE PROCEEDING WITH MECHANICAL ASSEMBLY

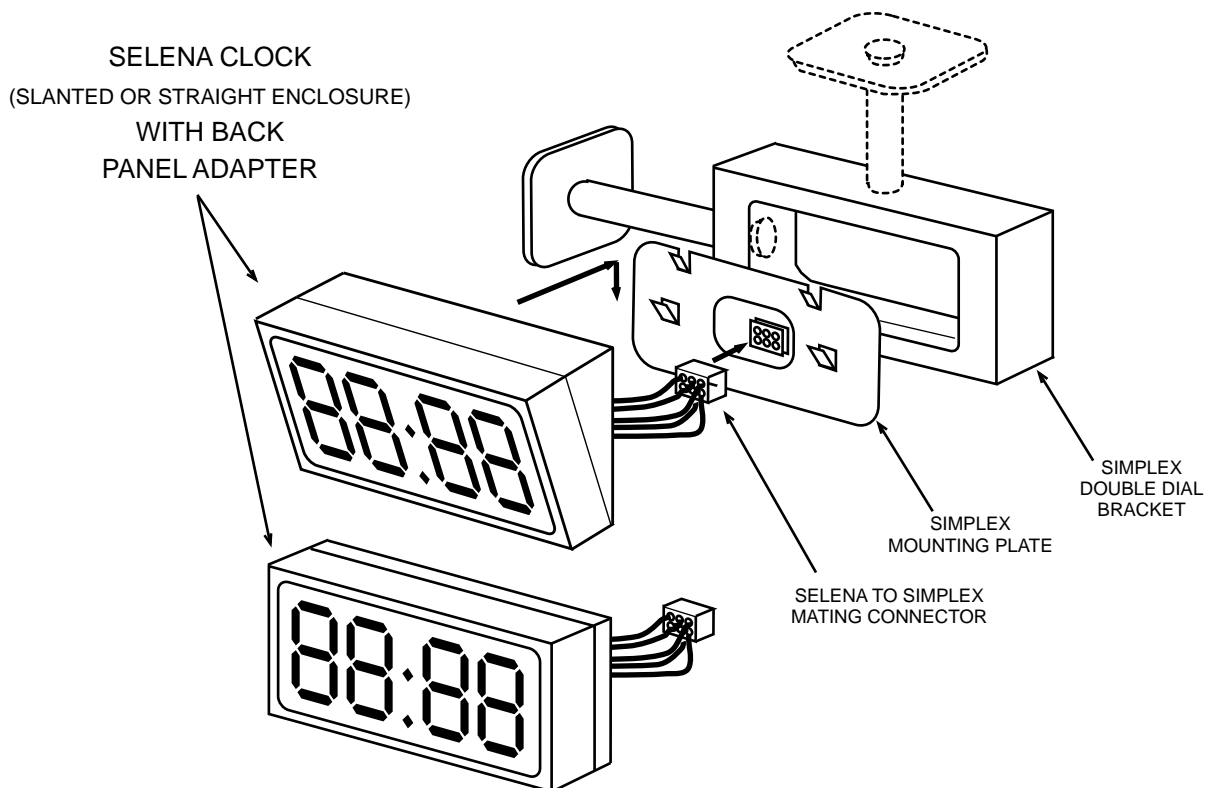

For direct replacement of Simplex clocks with SELENA.

1. Plug in mating Supply/Sync connector plug directly into existing receptacle in Simplex mounting bracket.
2. Slide SELENA clock vertically onto mounting plate and push it down to secure clock on mounting tabs.
3. Using Remote Control, enable required Sync mode.  
(mode may be changed at any time via remote control without disconnecting power)

NOTE:

- A) For Power line Carrier Sync SELENA with option #724 needed
- B) For Twisted Pair (RS-485) Sync SELENA with option #725 needed
- C) For 2-wire BCD Sync SELENA with option #726 needed

ALL SYNC OPTIONS MAY BE INSTALLED IN THE SAME SELENA CLOCK, BUT ONLY ONE MAY BE ENABLED (VIA REMOTE CONTROL) FOR PROPER OPERATION.